



PLAN VIEW

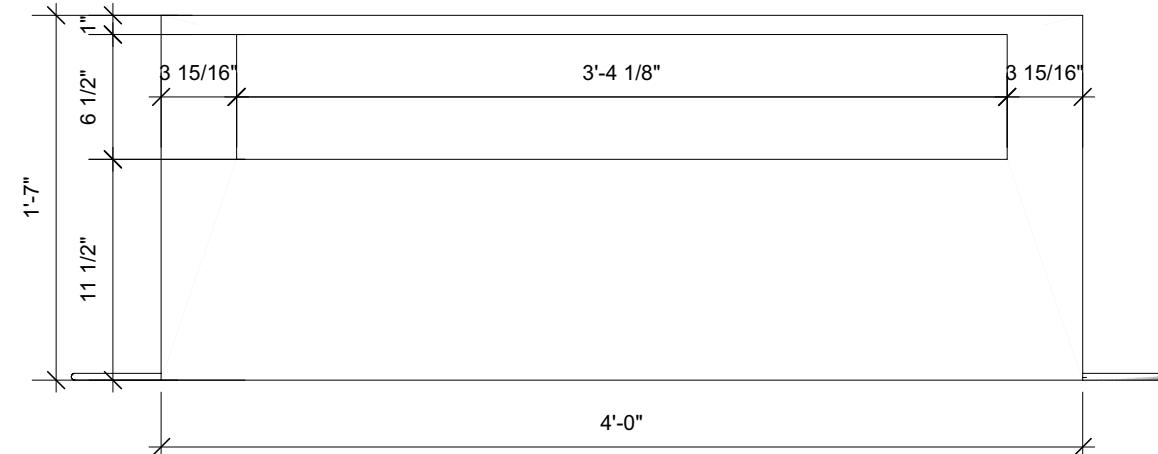


ELEVATION VIEW - INLET

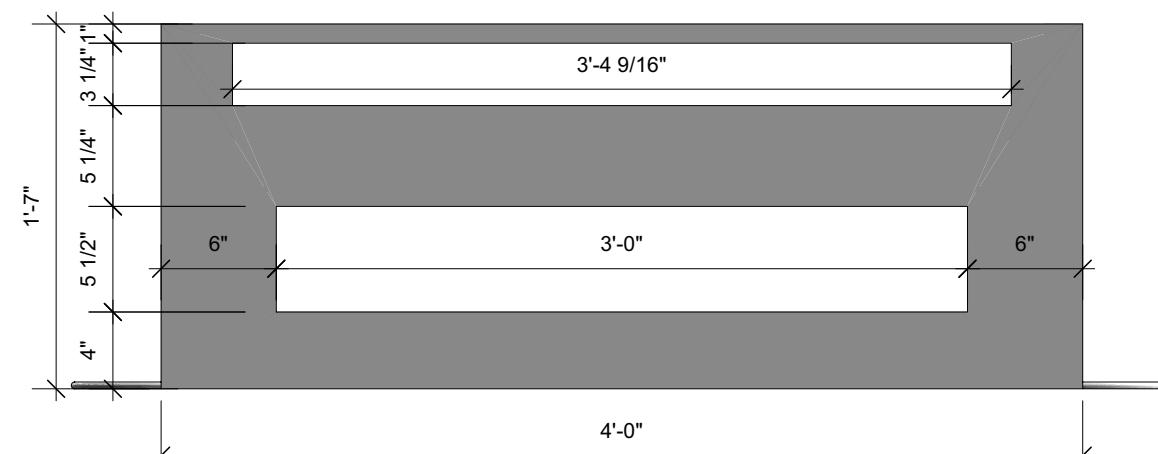

ELEVATION VIEW - OUTLET


RAIN GUARDIAN
FORTRESS
PRETREATMENT
CHAMBER

ISOMETRIC VIEW - CHAMBER INLET

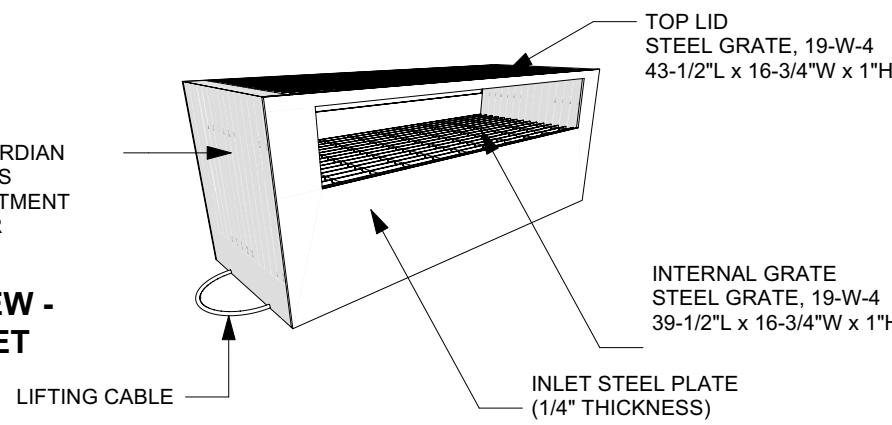


RAIN GUARDIAN
FORTRESS
PRETREATMENT
CHAMBER

ISOMETRIC VIEW - CHAMBER OUTLET

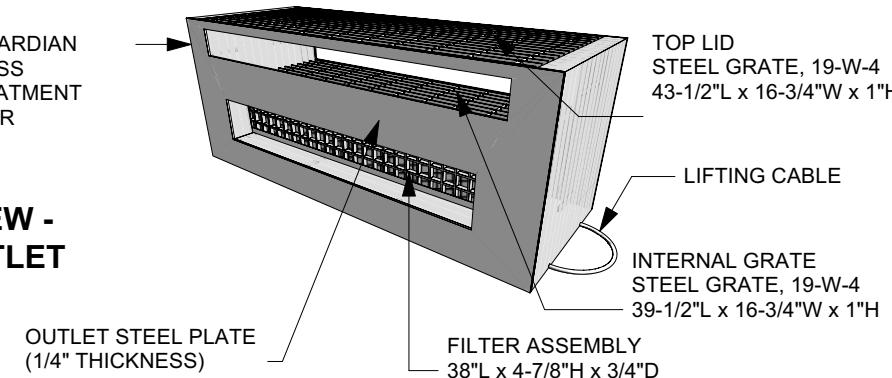

HANDLING INSTRUCTIONS

DO NOT LIFT FORTRESS
BY METAL FACE PLATES

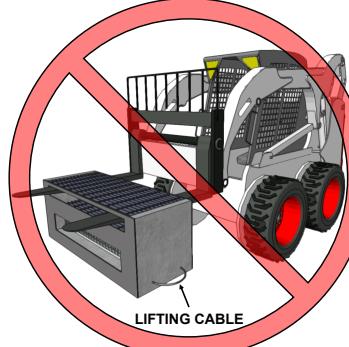

LIFT ONLY BY CABLES
WITH SPREADER BAR

SPECIFICATIONS

1. STEEL REINFORCED, COLD JOINT SECURED MONOLITHIC CONCRETE STRUCTURE (3.26 CF CONCRETE, 499 LBS, 1.36 CF STORAGE VOLUME), CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 4,500 PSI AT 28 DAYS. CONCRETE AIR ENTRAINED (5% TO 8.5% BY VOLUME). MANUFACTURED AND DESIGNED TO ASTM C858.
2. TWO-POINT PICK (EMBEDDED LIFTING CABLES)
3. INTERNAL GRATE - STEEL GRATE (25 LBS/PIECE, 1" THICK), 361 LB CONCENTRATED LOAD OR 206 LB/SQ-FT UNIFORM LOAD
4. TOP LID - STEEL GRATE (27 LBS/PIECE, 1" THICK), 361 LB CONCENTRATED LOAD OR 206 LB/SQ-FT UNIFORM LOAD
5. STEEL FACE PLATE (INLET AND OUTLET) - A36 1 1/4" THICKNESS
6. REMOVABLE FILTER ASSEMBLY (FIBERGLASS GRATE WITH FILTER AND ALUMINUM CHANNEL)

INSTALLATION NOTES

1. EXCAVATE AN AREA WITH DIMENSIONS OF AT LEAST 4'-6" L X 2'-0" W FOR THE RAIN GUARDIAN. THE DISTANCE FROM THE BACK OF THE CURB MAY VARY BASED ON SITE CONDITIONS, BUT CONSIDERATIONS SHOULD INCLUDE SLOPE OF THE INLET AND BASIN SIDE SLOPES ADJACENT TO THE RAIN GUARDIAN. POSITION RAIN GUARDIAN SO PRIMARY OUTLET ALIGNS WITH TOE OF BASIN SIDE SLOPE TO AVOID SOIL INTERFERENCE WITH REMOVABLE FILTER WALL. THE EXCAVATION DEPTH SHOULD BE 1'-7" BELOW THE GUTTERLINE ELEVATION AT THE RAIN GARDEN INLET TO ACCOMMODATE THE 6" AGGREGATE BASE, 4" RAIN GUARDIAN BASE, AND 9" PONDING DEPTH.
2. INSTALL AN AGGREGATE BASE, COMPACTED TO 95% STANDARD PROCTOR, WITH DIMENSIONS OF AT LEAST 4'-6" L X 2'-0" W X 6" D. FINISHED TOP ELEVATION OF AGGREGATE TO BE PRECISELY 1'-1" BELOW THE GUTTER LINE ELEVATION AT THE RAIN GARDEN INLET.
3. SET RAIN GUARDIAN ON THE PREPARED AGGREGATE BASE. THE RAIN GUARDIAN INLET WILL BE 1-1/2" BELOW THE GUTTERLINE ELEVATION TO ACCOMMODATE A SLOPED INLET FROM THE GUTTER TO THE RAIN GUARDIAN.
4. INSTALL FRAMING FOR INLET BETWEEN RAIN GUARDIAN AND BACK OF CURB. TOP ELEVATIONS OF THE FRAMING SHOULD MATCH THE TOP OF THE CURB ON THE STREET SIDE AND THE TOP OF THE RAIN GUARDIAN ON THE BIORETENTION SIDE.
5. INSTALL EXPANSION/CONTRACTION JOINT MATERIAL OR A SHEET OF POLY TO SERVE AS A BOND BREAK BETWEEN RAIN GUARDIAN AND CONCRETE INLET BEFORE POURING INLET.
6. SIDE CURBS OF THE POURED INLET MUST HAVE AN INSURMOUNTABLE PROFILE TO PREVENT WATER FLOW FROM OVERTOPPING THE DOWNSTREAM SIDE OF THE INLET.
7. INSTALL REMOVABLE FILTER. THE FILTER SHOULD BE INSTALLED IN THE CHANNEL AT THE RAIN GUARDIAN OUTLET WITH THE FILTER FABRIC FACING THE RAIN GUARDIAN INLET.
8. INSTALL INTERNAL GRATE AND THEN TOP LID.

REVISION HISTORY

REV	BY	DATE	DESCRIPTION
A	MDH	10/04/23	FORTRESS
SCALE	VARIABLE		
U.S. PATENT NOS.	8,501,016 AND 8,858,804		